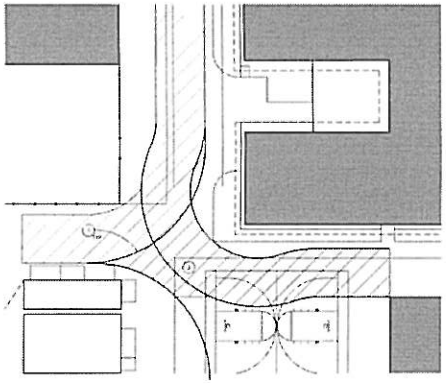

FIRE SITE PLAN - ENLARGED

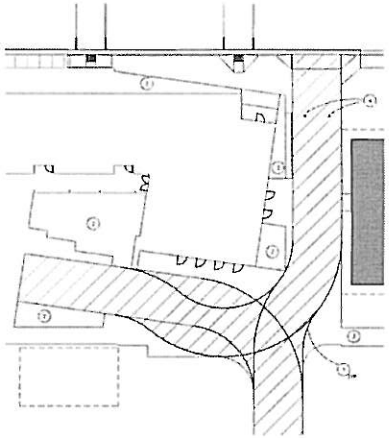

FIRE SITE PLAN - ENLARGED

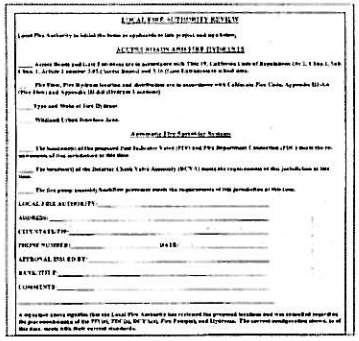

LOCAL FIRE AUTHORITY REVIEW

Local Fire Authority to initial the items as applicable to this project and sign below.

ACCESS ROADS AND FIRE HYDRANTS

Access Roads and Local Fire access are in accordance with Title 19, California Code of Regulations (Chs. 1, Chs. 1, Sub Chs. 1, Article 1 section 1.07, Article Sections) and 5.16 (Cross Connections in school sites.

The Fire, Fire Hydrant location and distribution are in accordance with California Fire Code, Appendix III-A-A (Fire Flow) and Appendix III-B-B (Hydrant Location)

Type and Make of Fire Hydrant

Wildland Urban Interface Area.

Automatic Fire Sprinkler System

The installation of the proposed Post Indicator Valve (PIV) and Fire Department Connection (FDC) meet the requirements of this jurisdiction at this time.

The installation of the Detector Check Valve Assembly (DCVA) meets the requirements of this jurisdiction at this time.

The fire pump assembly/backflow preventer meets the requirements of this jurisdiction at this time.

LOCAL FIRE AUTHORITY: _____

ADDRESS: _____

CITY STATE ZIP: _____

PHONE NUMBER: _____ DATE: _____

AUTHORIZED BY: _____

RANK/TITLE: _____

COMMENTS: _____

A signature above signifies that the Local Fire Authority has reviewed the proposed location and was satisfied regarding the fire protection of the FDC, PIV, DCVA, Fire Pumps, and Hydrants. The current configuration shown, as of this date, meets NFPA 13 current standards.

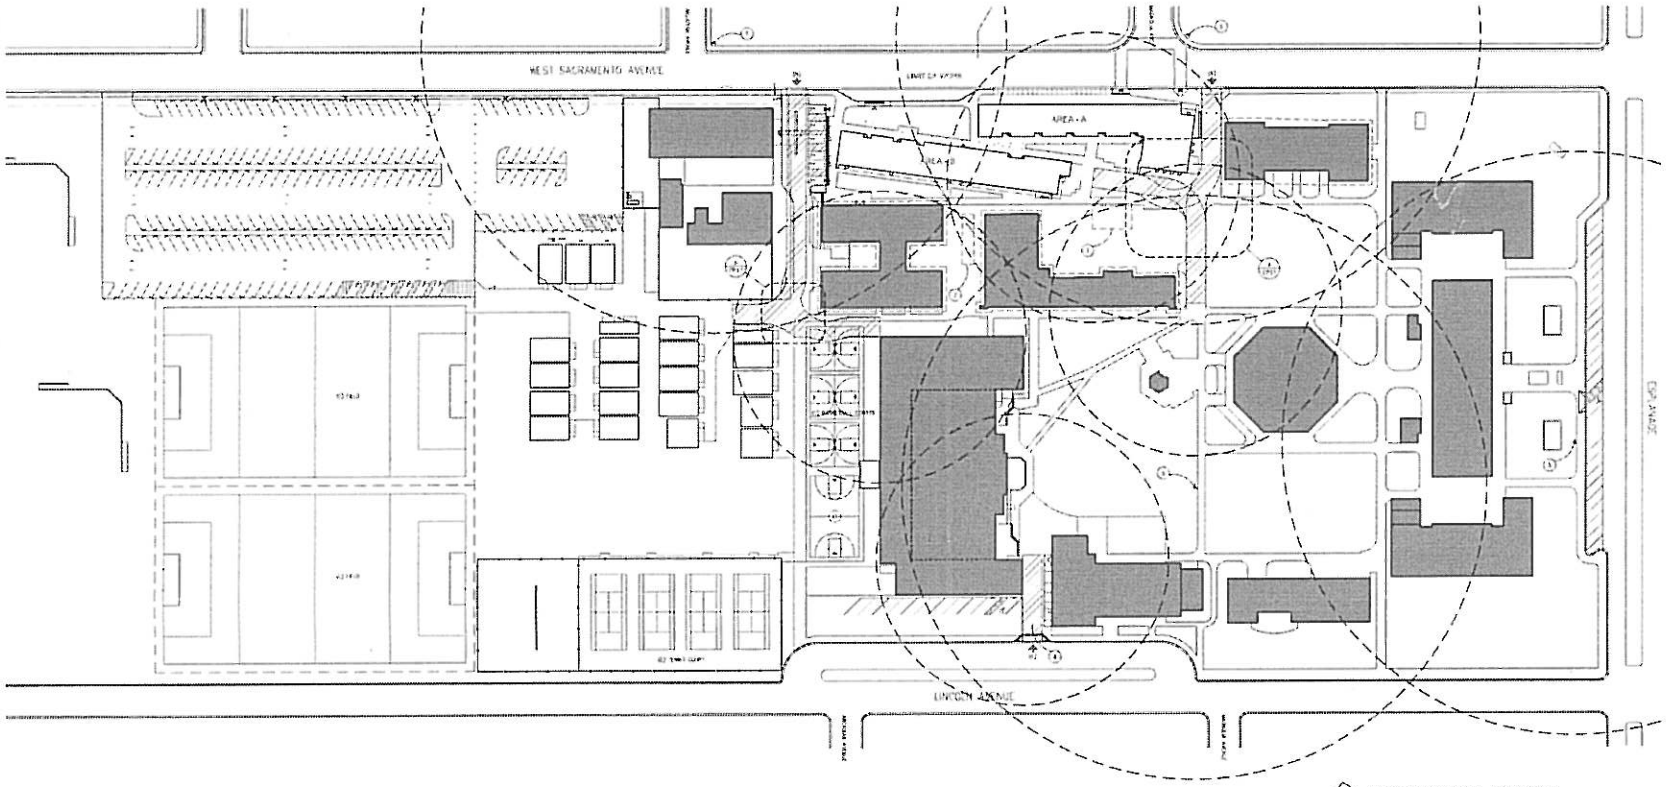

FIRE SITE PLAN - OVERALL

LEGEND NOTES

1. FIRE LANE - SIGNAGE AND STRIPING PER CITY OF CHICO STANDARDS
2. PEDESTRIAN WALK
3. FIRE HYDRANT
4. FIRE DEPARTMENT CONNECTION
5. FIRE HYDRANT
6. FIRE LANE
7. FIRE BUILDING TO BE PROVIDED BY THE OWNER

SYMBOL LEGEND

- NEW CLASSROOM BUILDING
- EXISTING BUILDINGS
- EX. WELL FIRE LANE
- FIRE LANE - AREA CIRCLE
  FIRE LANE - TRAFFIC
  FIRE HYDRANT - 300'-0"

GENERAL NOTES

1. FIRE HYDRANTS ARE SPACED WITH 1/2" DIA. VITRIFIED TILE, 300' - 0" MAXIMUM SPACING BASED ON 300' - 0" AND THERE SHALL BE NO DEAD ENDS.
2. FIRE HYDRANT AND WATER MAINS SHALL BE IN ACCORDANCE WITH THE CITY OF CHICO STANDARDS, CITY OF CHICO.
3. FIRE HYDRANTS ARE SPACED WITH AN AUTHORIZED FIRE HYDRANT.

KEY PLAN



No. C29637

LOCAL FIRE AUTHORITY REVIEW PLAN - (FOR REFERENCE ONLY)

CHICO HIGH SCHOOL

NEW CLASSROOM BUILDING

CP3.1

DLR Group

Architecture Engineering Planning Interiors