


# City of Chico Fire Prevention and Life Safety Bureau

## EMERGENCY ACCESS REQUIREMENTS


Any portion of a Structure must be within 150' (measured as a fire hose would lay) of an access point to which a fire apparatus is able to arrive. An approved Access Lane made of an all weather surface (capable of supporting a 73,000 lb fire engine/truck) and a minimum width of 20' is required to provide access to this point. If the Access Lane is longer than 150' then an approved Turn-around is required. See diagrams below for details. For alternatives to the design standards: contact the Chico Fire Prevention Bureau at 897-3400. - For public streets, see CMC Title 18R, Standard S-18.



**Fire Lane Required on Both Sides**

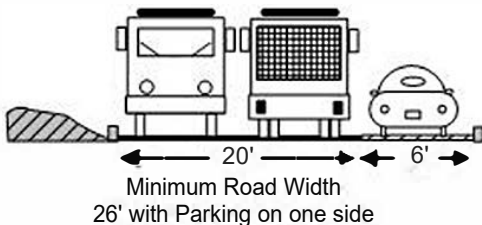


**Fire Lane Required on One Side Only**

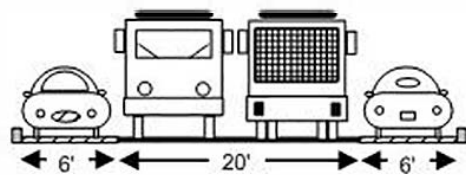


Minimum Road Width  
32' with Parking on both sides

**No Fire Lane Required**


### REQUIRED ACCESS

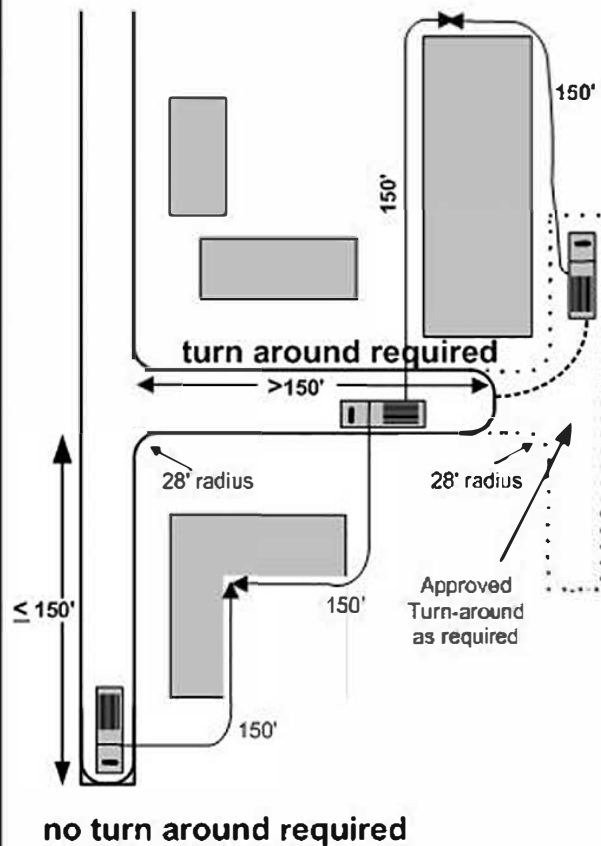

### TURNING RADII (minimum dimensions)

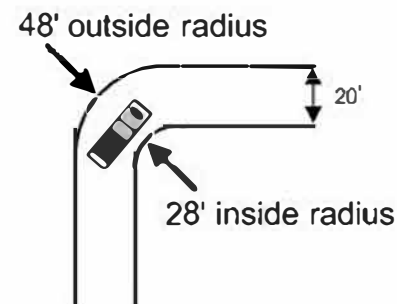

### APPROVED TURN-AROUNDS (minimum dimensions)

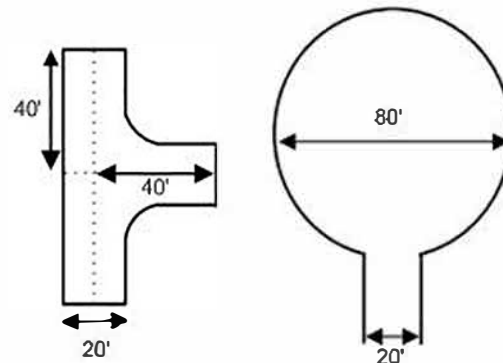

For up to two, single family residences and on-site access

Standard street cul-de-sac (public and private)