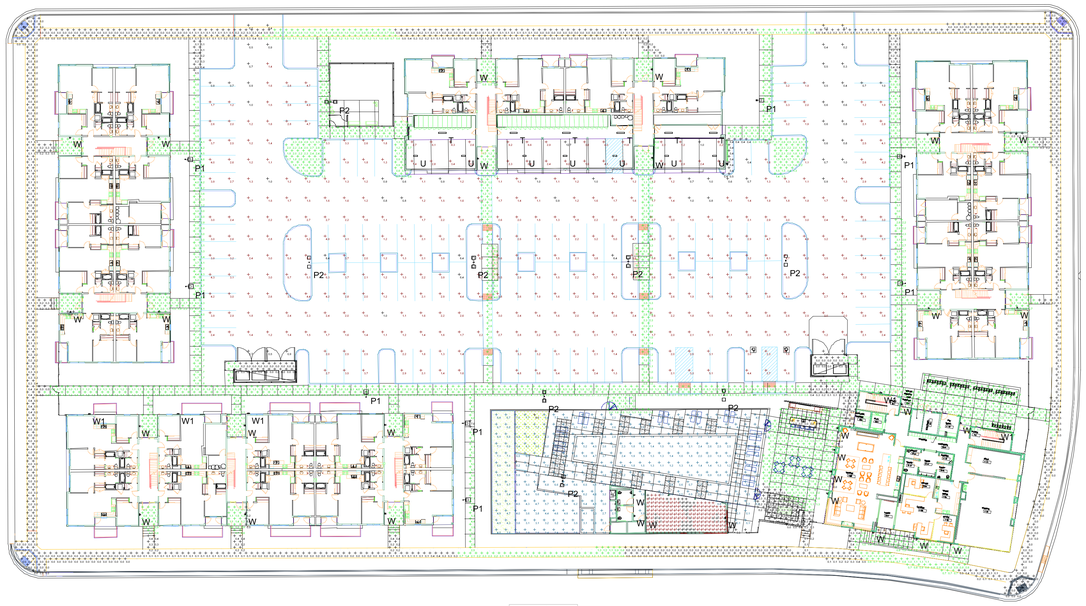

Plan View
Scale - 1/32" = 1ft

	P1	8	DSX1 LED P2 40K T3M MVOLT	DSX1 LED P2 40K T3M MVOLT	LED	1	8641	0.9	70
	P2	8	DSX1 LED P2 40K T5M MVOLT	DSX1 LED P2 40K T5M MVOLT	LED	1	9235	0.9	140
	T	6	LBL4 40L EZ1 LP840	LBL4, 4000 NOMINAL LUMENS, 4000K.	LED	1	4600	0.9	41
	U	7	LBL2 20L EZ1 LP840	LBL2, 2000 NOMINAL LUMENS, 4000K.	LED	1	2267	0.9	23
	W1	5	DSXW1 LED 10C 700 40K T3M MVOLT	DSXW1 LED WITH (1) 10 LED LIGHT ENGINES, TYPE T3M OPTIC, 4000K, @ 700mA.	LED	1	2757	0.9	26.2
	W	31	ZENITH LG 32.2W LED UNV SM 40K	2-44 LED 22"ARRAYS ZENITH W LARGE LUMINAIRE ALUM REFL w/WHITE 75% DR ACRYLIC LENS & SILVER TRIM ACELEDS #AC-44CD1.5UVTS @ 700mA	LED	1	1494	0.9	26

COVERED PARKING	+	5.0 fc	12.7 fc	1.0 fc	12.7:1	5.0:1
DRIVE / PARKING	+	2.4 fc	6.4 fc	0.1 fc	64.0:1	24.0:1
POOL AREA	+	3.5 fc	8.0 fc	0.0 fc	N/A	N/A
POOL HOUSE	+	1 fc	2 fc	0 fc	N/A	N/A
SIDEWALKS	+	1.4 fc	7.6 fc	0.0 fc	N/A	N/A

P1	14.00
P2	14.00
T	9.00
U	9.00
W	7.00
W1	12.00

POLE LIGHT
P, P1

WALL-MOUNT LIGHT
W

WALL-PACK LIGHT
W1

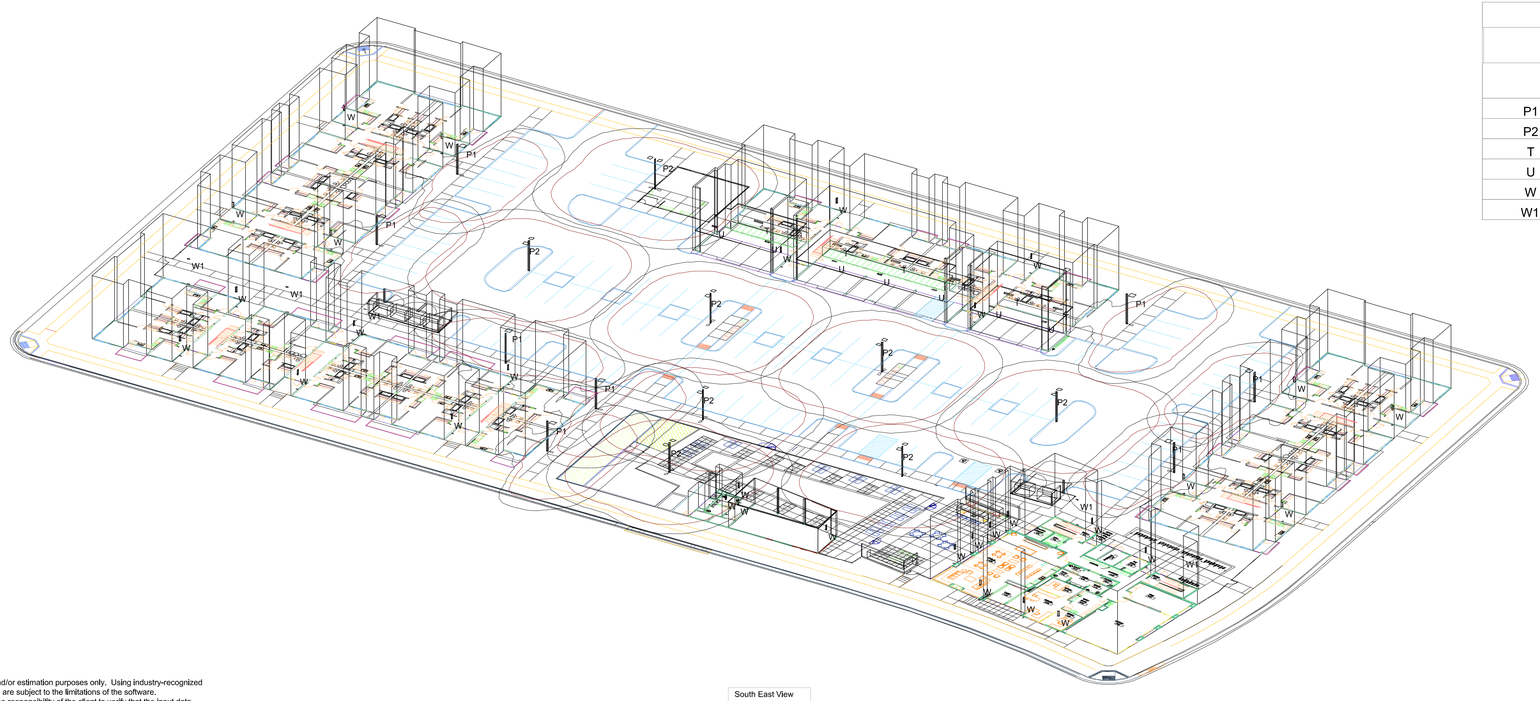

South East View

Disclaimer
Photometric analyses performed by CJS Lighting are intended for informational and/or estimation purposes only. Using industry-recognized software, calculations correspond to the information provided to CJS Lighting, and are subject to the limitations of the software.
Assumptions may be made for information that is not provided or available. It is the responsibility of the client to verify that the input data is consistent with actual field conditions. Performance may differ as a result of end-user environment and application.
Due to the above considerations, CJS Lighting does not guarantee that actual light levels measured in the field will match initial calculations, and recommend that drawings be submitted to a certified electrical engineer for verification.

CJS Lighting

MERIAM PARK
SPRINGFIELD APARTMENTS

Designer
DEW
Date
12/21/2018
Scale
AS NOTED
Drawing No.
E01
Summary
SITE
PHOTOMETRIC